


Absicherung bauseits
nach DIN EN 60204-1
Überstromschutz-
organ erforderlich!

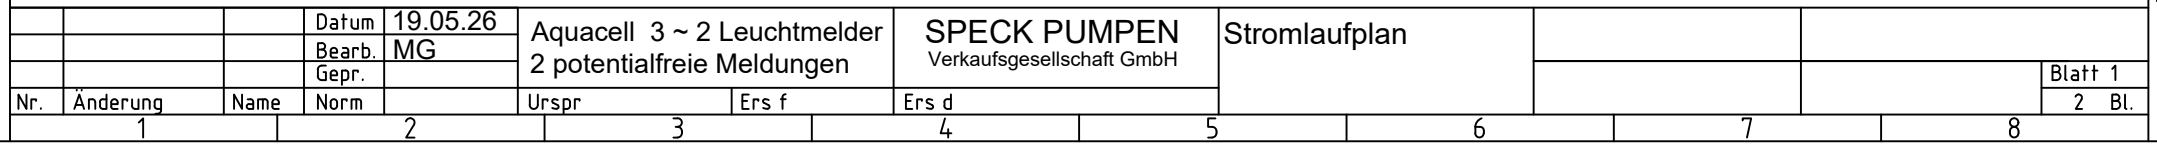

01/8/-1F1:97
L1.1
230V~ / 50Hz

L1.1
230V~ / 50Hz

1Q1 - 3RT20 -17- 1AP01
1F1 - 3RU2116-1HB0 (5,5-8,0A)

K1 - BC7933N81,230V50HZ, 5-100s
K2 - RIF 1 RPT LV 230AC / 2x21

F1 - PT4 - TG / 3,15 A
1S1 - UR1 / 6ZM / X85

1P1 - 3SU1401-1BF60 + 3SU1001. - weiss 230V~
1P2 - 3SU1401-1BF20 + 3SU1001.- rot 230V~

Gehäuse CI-K4 -160-M


N 01/8
PE 01/8

Betrieb

Überstrom

Betrieb

kein
Überstrom

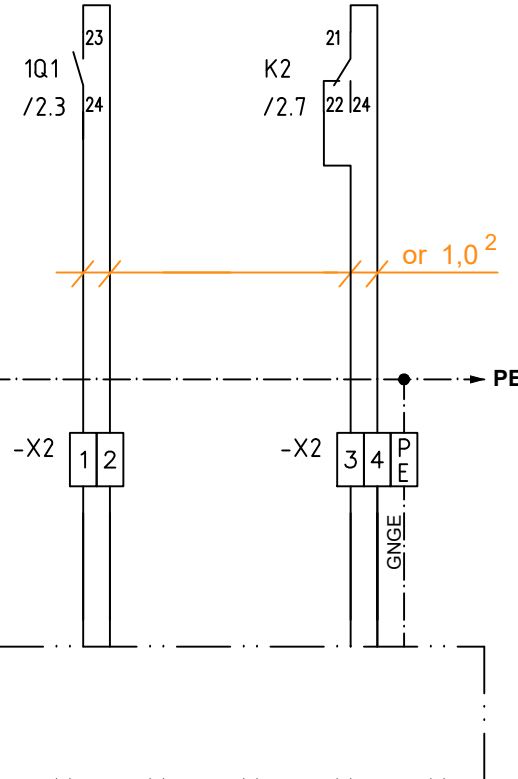

			Datum	19.05.26	Aquacell 3 ~ 2 Leuchtmelder 2 potentialfreie Meldungen		SPECK PUMPEN Verkaufsgesellschaft GmbH		Stromlaufplan					
			Bearb.	MG										
			Gepr.											
Nr.	Änderung	Name	Norm		Urspr	Ers f	Ers d							Blatt 2
1		2		3		4		5		6		7		8
											2 Bl.			